



## **Network Loss Factor Methodology 2013-2014**

**Date: February 2013**

## Table of Contents

<b>1. Introduction .....</b>	<b>1</b>
<b>2. Background .....</b>	<b>1</b>
<b>3. Definitions and Abbreviations .....</b>	<b>2</b>
<b>4. Network Energy Losses .....</b>	<b>3</b>
4.1 Reconciliation Losses .....	3
4.2 Technical Losses.....	3
4.3 Low Voltage (LV) Network and Non-Technical Losses.....	4
<b>5. Load Loss Factor .....</b>	<b>4</b>
<b>6. DLF Calculation .....</b>	<b>5</b>
6.1 Reconciliation Loss Factor.....	5
6.2 Site Specific Loss Factor .....	5
6.3 Transmission (110kV).....	6
6.4 Sub-transmission Network (33kV line) Losses.....	6
6.5 Zone Substation Losses.....	6
6.6 HV Network (22/11/6.35 kV Line) Losses.....	7
6.7 Distribution Transformer Losses.....	7
6.8 Low Voltage Network Losses.....	7
6.9 Embedded Generator Losses.....	7
<b>7. Compliance Requirement .....</b>	<b>8</b>
<b>8. Network Loss Factor Summary .....</b>	<b>9</b>

## 1. Introduction

The Electricity Authority Code requires that Electricity Distributors calculate and publish Reconciliation Loss Factor or Distribution Loss Factor (DLF) for each loss factor code in the registry each year.

This report presents the DLFs that can be applied to customer's metered energy to recover upstream losses on Top Energy's Network (TEN) for the financial year 2013-2014. It also outlines the methodology, assumptions and data used for the calculation of the loss factors.

The methodology used in this calculation is based on the requirements set out in the Electricity Authority's "*Guidelines on the calculation and the use of loss factors for reconciliation purposes V2.1*"<sup>1</sup> issued on 1 November 2010.

The peak demand data for the calculation is extracted from the most recent SCADA data in addition to the forecast demand information as disclosed in Top Energy's Asset Management Plan. The Network model is built using DigSilent Powerfactory, detailed to the HV terminal of distribution transformers in order to calculate the Technical Losses at each stage of the Network.

This Network Loss Factor Methodology is available from Top Energy's website at [www.topenergy.co.nz/disclosurenetworkonly.htm](http://www.topenergy.co.nz/disclosurenetworkonly.htm)

## 2. Background

Electrical Energy Losses are the losses incurred in the transfer of electricity over a distribution network. Losses vary with line length and depend on the amount of power being transferred. Overall losses can vary from year to year as they depend on factors such as network configuration, utilization level, load profile and power factor of the system (level of reactive power support), etc.

It is important to calculate the losses attributable to the customers connected at each stage of the Network so they can be accurately charged for the portion of losses incurred to supply demand. Due to the vast number and significant diversity of the customers connected to the distribution network, it is not feasible to measure or calculate the losses caused by each individual customer.

A DLF, normally expressed as a multiplier, is used to estimate the difference between metered quantities at the input of a network and the sum of metered quantities at customer's metering points over a period of time. The DLF is calculated as  $1/(1-\text{loss ratio})$  where the loss ratio equals the average proportion of losses over the network.

EA Codes require DLF to be site-specific for certain types of connection points based on voltage or connection point classes. More specifically, the site-specific DLFs will be determined for a connection point:

- a. for an embedded generating unit with a name plate rating of 10MW or more;
- b. for a customer with actual or forecast load of more than 40GWh or an electrical demand of more than 10MW;
- c. for a market network service provider;
- d. for the interconnection point between two or more distribution networks;

---

<sup>1</sup> This document can be made available from <http://www.ea.govt.nz/> This document contains detail requirements and criteria required by The Electricity Authority for loss factor calculation, methodologies and processes.

On the other hand, the non-site specific DLFs calculated in this report are to be applied to the metered energy at each stage of the Network. The DLFs representing the energy losses at each stage of the network are expressed as a percentage of the energy delivered at that level of the network, irrespective of whether it is delivered to customers at the same stage or to customers at the lower stage of the network.

### **3. Definitions and Abbreviations**

1. EA: Electricity Authority
2. DLF : Distribution Loss Factor or Reconciliation Loss factor
3. Embedded Generation: A generator which operates one or more generating units that are directly connected to a distribution network and injects energy into a distribution network
4. SCADA: Supervisory Control And Data Acquisition: SCADA systems are typically used to perform data collection and control at the supervisory level in a distribution network
5. LLF: Load Loss Factor: The LLF is the ratio between the instantaneous losses incurred at the peak load and the average instantaneous losses over two years
6. ICC: Individually Calculated Customers: The customer for which the EA Codes require site-specific loss factor to be calculated
7. GXP: Grid Exit Point
8. Utilisation Factor (UF): Utilisation factor is the ratio of the maximum coincident KVA demand on the component to the rating of the component.
9. LV : Low Voltage
10. HV: High Voltage
11. TH : Total number of hours in two years
12. THH : Total number of half hourly recordings in two years

## 4. Network Energy Losses

Network Energy losses are categorised mainly in three different categories as following:

### 4.1 Reconciliation Losses

The Electricity Authority's "Guidelines on the calculation and the use of loss factors for reconciliation purposes V2.1" recommends Reconciliation Losses to be calculated from the immediate past 24 months' energy injection and consumption information for an electrically connected network.

These losses are the difference between energy purchased and sold in the Top Energy Network. Top Energy takes into account the energy injection from Transpower at the Grid Exit Point (KOE) and the energy injection from Ngawha Geothermal Power Station at sub-transmission level when calculating losses on the network.

### 4.2 Technical Losses

There are two components of technical losses on a distribution network.

- a. Load Losses: These losses depend on the electricity being supplied through the distribution network. These losses are proportional to the square of the current being supplied through the network equipment such as sub-transmission, distribution and, LV lines, zone substation and distribution transformers. These losses are also known as copper losses or  $I^2R$  losses.
- b. No-load Losses: These losses are fixed and do not depend on the load. These losses arise from the standing or Iron losses of the Network transformers (Zone substation and Distribution).

Load Losses are calculated on the relevant part of the network under peak demand condition using DigSilent PowerFactory load flow package. The associated energy losses are calculated using Load Losses and appropriate Load Loss Factor<sup>ii</sup> (LLF) as follows:

$$\text{Load Energy Losses (kWh)} = \text{Load Losses at Peak Demand (kW)} \times \text{TH (hrs)} \times \text{LLF} \quad (i)$$

Peak Losses are modelled in DigSilent PowerFactory using peak demand forecast for the year 2013. The LLF for zone substations is calculated using the previous two years SCADA data. Metering data is used to calculate LLF for site specific industrial customers. The peak load energy losses (kWh) are calculated by multiplying the load losses with total hours and associated LLF. These load losses includes transmission (110kV), sub-transmission (33kV), substation transformers (110/33kV, 33/11kV, 33/22kV) and distribution line (22kV, 11kV and 6.35kV) losses.

The No-load Losses for substation transformers are obtained from manufacturer's data and test sheets to feed into DigSilent PowerFactory. The associated energy losses are calculated as follows:

$$\text{No-Load Energy Losses (kWh)} = \text{No-Load Losses (kW)} \times \text{TH (hrs)} \quad (ii)$$

The LLF is not applied to No-load Losses as these losses are not dependent on the transformer loading. The No-load Losses are multiplied by total hours to calculate no-load energy losses in two-year period.

---

<sup>ii</sup> Load Loss Factor is explained in detail in Section 5

The Load and No-load Losses for distribution transformers are obtained from the manufacturer's data sheets for different size transformers. Average losses are calculated for distribution transformers of different sizes, including SWER isolating transformers. The energy losses associated with No-load Losses for each type of distribution transformer are calculated as per Equation ii and they are added together in order to calculate total no-load energy losses.

The energy losses associated with Load Losses for each type of distribution transformer are calculated as Equation iii and added together in order to calculate total load energy losses:

$$\text{Load Energy Losses (kWh)} = \text{Load Losses (kW) at Max. Rating} \times (\text{UF (\%)}^2) \times \text{LLF} \times \text{TH (hrs)} \quad (\text{iii})$$

The utilisation factor (UF) is explained in sub-section 6.6. The UF value used is determined by the kVA rating of distribution transformer.

#### 4.3 Low Voltage (LV) Network and Non-Technical Losses

EA Codes define the Non-technical Losses as the difference between Reconciliation Losses and Technical Losses for the entire network. These losses include unaccounted energy due to theft, meter inaccuracy and minor billing errors.

Due to the low level of LV network loading and modelling data, it is impractical to calculate with utmost accuracy, the LV network's load losses using load flow studies. With such limitations, Top Energy attributes LV Network losses as part of the Non-technical Losses, while also considering a proportion of Non-technical Losses for theft, meter inaccuracy and minor billing errors. It is assumed that Non-technical Losses primarily occur at Low Voltage level. Therefore Non-technical Losses are only allocated to LV network customers. Such losses also include losses incurred on streetlight circuits.

$$\text{LV and Non-technical Energy Losses} = \text{Reconciliation Losses} - \text{Total Upstream Losses} \quad (\text{iv})$$

### 5. Load Loss Factor

The LLF is the ratio between the average instantaneous losses over the immediate 24 months, and the instantaneous losses incurred at the peak load during the same period. It is proportional to the square of the load and expressed as:

$$\text{LLF} = \frac{\sum_{n=1}^{\text{THH}} \left( \frac{\text{Load}_n^2}{\text{PeakLoad}^2} \right)}{\text{THH}} \quad (\text{v})$$

Where: Load<sub>n</sub> = the 30-minute average load in the nth period  
 THH = the number of 30-minute load recordings in two years  
 Peak load = the highest 30-minute average load in two years

LLFs are calculated for each zone substation in Top Energy, as well as for transmission substations and the site specific industrial customers. These LLFs are calculated using the SCADA data for the last 24 months for all zone substation and transmission substations, and metering data for the same period for the site specific industrial customers.

## 6. DLF Calculation

This section presents the methodology used to calculate site-specific DLFs for any ICC and non-site specific DLFs for each stage of the network. Figure 1 represents the application of the DLFs at different network stages. This figure does not include the application of any site-specific ICC.

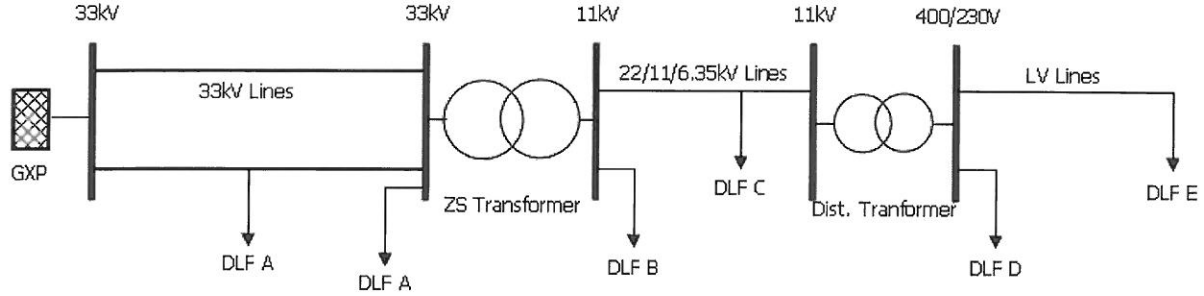


Figure 1: DLF Application at Different Network Stages

### 6.1 Reconciliation Loss Factor

Reconciliation Loss Factor is calculated using reconciliation losses

$$DLF_R = 1 + \frac{\text{Reconciliation Losses (kWh)}}{\Sigma \text{ Energy Consumption (kWh) for Entire Network}} \quad (vi)$$

### 6.2 Site Specific Loss Factor

EA Codes require site-specific loss factors to be calculated for a customer (Individually Calculated Customers ICC) with actual or forecast load of more than 40GWh per annum or an electrical demand of more than 10MW.

Energy Losses directly associated with an ICC are determined by the point of connection on the network (i.e. Sub-transmission level, Zone Substation level, etc). The losses are only calculated upstream of the point of connection. For example, if an ICC is connected to an 11kV zone substation bus, only losses in the sub-transmission lines and zone substation transformers will be considered.

When an asset is shared between non-site specific load and an ICC, or between more than one ICC, all the losses need to be allocated fairly based on peak demands. For example, considering a large customer with 10 MW peak demand connected to a Zone Substation with a 14 MW peak demand. If load flow studies show total losses in the upstream Network due to the large customer, and all other connected load is 360kW, then the losses attributable to the large customer are:

$$360 \text{ kW} \times 10 \text{ MW} / 14 \text{ MW} = 257 \text{ kW}$$

Site-specific DLFs are calculated for the site specific industrial customers (IND) on the Network. Load Losses for these customers are calculated using load flow analysis based on the customer's forecast peak demand and network load data. The model includes the network connection and the interconnection assets used to transfer the energy between the customer point of connection, the Network point of connection, and/or Ngawha Generations. The No-load Losses for the zone substation transformers are added to the Load Losses in order to obtain the total losses. The total losses are allocated to an ICC and converted into energy losses per annum using a specific LLF for the corresponding ICC. DLF for an ICC is calculated as follows:

$$DLF \text{ for ICC} = 1 + \frac{\Sigma \text{ Losses (kWh) attributable to an ICC}}{\Sigma \text{ Energy Consumption (kWh) for an ICC}} \quad (vii)$$

The losses and energy allocated to all ICCs are then removed from the total network losses and total network energy consumption. The remaining losses and energy are used to calculate DLFs for each stage of the network as follows:

$$DLF = 1 + \frac{\Sigma \text{ Losses (kWh) for each stage of Network – associated ICC losses}}{\Sigma \text{ Energy Consumption (kWh) for all section downstream including that section – associated ICC consumption}} \quad (viii)$$

The following sections explain the methodology used to estimate energy losses for each hierarchical stage of the Top Energy Network.

### 6.3 Transmission (110kV)

With effect from 01 April 2012, Top Energy gained ownership of the 110kV assets at the Kaikohe and Kaitaia GXP's inclusive of the 110kV KOE-KTA transmission circuit. Based on the effective date of ownership transfer, the 110kV losses are included in the Loss Factor Calculations

The most recent energy injection and consumption data from 01 April 2012 is used in the Loss Factor calculation.

Load flows are performed for the individual forecasted peaks of KOE and KTA to determine the losses of the substations and the KOE-KTA 110kV line. The LLF is calculated using the 30min metered data. The losses are calculated as per Equation i.

### 6.4 Sub-transmission Network (33kV line) Losses

Specific load flow studies for the northern and southern 33kV networks are implemented to calculate the Load Losses in 33kV lines at peak demand. The forecast peak demand for each 33/11kV substation is used.

The LLFs are calculated at both transmission substations using respective 30-minute averaged zone substation SCADA data, and applied to the Load Losses of the 33kV lines supplied from each transmission substation, thus calculating associated energy losses as per Equation i.

### 6.5 Zone Substation Losses

Zone substation models are developed, and load flow studies are carried out using the forecast peak demand for each 11kV distribution feeder to obtain the Load Losses at peak demand.

The LLFs are calculated for each zone substation using 30-minute averaged feeder SCADA data. LLF for zone substations are then averaged individually, and thus applied to zone substation Load Losses to calculate associated energy losses.

The No-load Losses for all zone substation transformers are obtained from manufacturer's data sheets. Energy losses associated with No-load Losses of the zone substation transformers are calculated as per Equation ii.



The total zone substation losses are then added to upstream losses (sub-transmission line losses) to calculate the DLF at zone substation level.

## **6.6 HV Network (22/11/6.35 kV Line) Losses**

Top Energy's HV Network is modelled using GIS data. Backbone models for each individual feeder are developed, starting from the 11kV bus at respective zone substation. The models also include 2 wire and SWER lines with isolating transformers. All spur lines with length less than 500m are not included in the model for simplicity. All distribution transformers and spurs mentioned above are modelled as lump loads on HV feeder. Load flow studies are implemented on all feeders using corresponding forecast peak demand to obtain the Load Losses.

LLFs for each zone substation, as per Equation v, are applied to HV feeders supplied from respective zone substation to obtain associated energy losses on each feeder as mentioned in sub-section 4.2. Energy losses for all distribution feeders in the Network are aggregated in order to calculate the DLF for the entire HV Network.

## **6.7 Distribution Transformer Losses**

The Load and No-load Losses incurred in distribution transformers are obtained from Manufacturer's data sheets. Average losses are calculated for transformers including SWER isolating transformers categorized by type and size. The average utilization factor for the entire Top Energy Network is used to calculate Load Losses as follows:

$$\text{Load Losses} = \Sigma (\text{Losses at Rated MVA}) \times (UF)^2$$

The number of transformers of each size is obtained from Top Energy's GIS database as disclosed in Top Energy's Asset Management Plan.

On average, the utilization factor for Top Energy's distribution transformers is approximately 30% for transformers up to 300kVA, and approximately 40% for transformers above 300kVA. This information is obtained from randomly selected transformer load logging data on the entire network. As Top Energy does not have maximum demand indicators on its distribution transformers, this selective load logging data are considered to be the most reliable data available.

LLFs for the northern and southern network zone substations are averaged to obtain one value for the entire Top Energy Network. The energy losses for the Load and No-load Losses are calculated as shown in sub-section 4.2.

The DLF calculation for distribution transformers will be carried out periodically in order to reflect potential changes in network topology or loading.

## **6.8 Low Voltage Network Losses**

The DLF at LV Network level is calculated using energy losses obtained as per sub-section 4.3.

## **6.9 Embedded Generator Losses**

EA Codes require calculating site-specific DLF for an embedded generating unit with actual generation of more than 10MW. Ngawha Geothermal Power Station, with 25MW total generating capacity is connected to the Top Energy network with a 10km 33kV line at Sub-transmission level. This section defines the methodology used to calculate DLF for Ngawha Generation.

The methodology considers all generation units as a single group and calculates their combined impact on overall network energy losses, using the Marginal Approach. The overall reduction or increase in energy losses caused by a group of embedded generators is then allocated to each generator based on generating capacity of individual generator. The DLF for embedded generators is then calculated as follows:

$$DLF = 1 + \frac{\Sigma \text{Energy Loss Reduction/ Increase}}{\Sigma \text{Energy Generated}} \quad (ix)$$

To analyse the total impact on energy losses due to Ngawha Geothermal Power Station, a load flow study is conducted with and without generators connected to the Top Energy Network. Network losses are calculated for both cases respectively, with the difference in the total network losses of these two cases calculated and converted into energy losses per annum, using the LLF calculated for Ngawha Geothermal Power Station. The difference in energy losses are not allocated to each generator. The total energy generated is obtained from the metering data at the power station. The DLF for Ngawha is calculated using Equation ix.

It has been noticed that, the Ngawha generation has negligible impact on the Top Energy Network losses. As a result, DLF for Ngawha Generation is 1.000. However, the Top Energy customers still benefit from the Ngawha Generation, as they do not have to pay for the losses which otherwise would have incurred on Transpower network in the absence of Ngawha generation.

## 7. Compliance Requirement

Once DLFs are calculated and applied to appropriate voltage level, the distributor shall submit to the Electricity Authority their proposed loss factors for the next financial year, prior to 1 March of each year regardless of whether or not there is any change from the previous financial year. Moreover, a report detailing loss factor calculation methodology and the detailed DLF / Reconciliation Losses for each voltage level shall be prepared for the submission to the Electricity Authority as per the requirement specified in the Electricity Authority's Guideline<sup>1</sup>. Such report must be submitted prior to 1 March of each year as well.

## 8. Network Loss Factor Summary

This section summaries the loss calculation methodology and the DLF for each stage of the network. Table 1 below is the summary of the method applied to calculate losses

Loss Type	Losses Applied to	Load Losses	No-Load Losses
Reconciliation Losses	Entire Network	Total Network Injection - Total Network Consumption	
Technical Losses	Transmission (110kV)	Using DigSilent PowerFactory Simulation	Using Manufacturer's Data sheet and Test sheets
	Sub-Transmission Network (33kV Lines)		
	Zone Substation		Using Manufacturer's Data sheet and Test sheets
	HV Network (22/11/6.35kV Lines)		N/A
	Distribution Transformers	Using Transformer count, % Utilisation Factor, Manufacturer's Data sheets and transformer Test sheets	Using Manufacturer's Data sheet and Test sheets
Non-Technical Losses	LV Network	Reconciliation Losses – Total Upstream losses.	

Table 1: Loss Calculation for Each Stage of the Network

Loss Type	Loss Factor Code	Applied to Customer Connected to	Since 110kV Ownership	
			Individual DLF	Cumulative DLF
Reconciliation Losses	DLF R	Entire Network (Reconciliation)	N/A	1.1124
Technical Losses	DLF A.1	Transmission Network (110kV Lines)	1.031	1.0313
	DLF A.2	Sub-Transmission Network (33kV Lines)	1.028	1.059
	DLF B	Zone Substation	1.004	1.063
	DLF C	HV Network (22/11/6.35kV Lines)	1.015	1.078
	DLF D	Distribution Transformers	1.019	1.097
Non-Technical Losses	DLF E	LV Network (Non-Technical + LV)	1.0154	1.1124
Site-Specific Customers	DLF I1 (JNL)	Site-Specific Customers	1.029	N/A
	DLF I2 (AFFCO)	Site-Specific Customers	1.074	N/A
	DLF G1 (NGA)	Site-Specific Customers-Generators	1.000	1.0000

Table 2: DLF for Each Stage of the Network and Site-Specific Customers – Financial Year 2013/14

	FYE2013 Forecast	Prior Mar 2012 During last 12 mths	Prior Mar 2011 & 2012 During the Last 24 Month	Less Industrials 24 mths prior Mar12	Network 24 mths prior March12
Total Energy Injected into Network	354,714,774	363,581,254	721,770,188	119,023,432	602,746,756
Total Energy Sold to Customers	333,715,496	332,722,420	660,112,276	115,787,237	544,325,040
Total Losses (kWh)	30,999,278	30,858,835	61,657,911	3,236,195	58,421,716
Loss percentage	8.5%	8.5%	8.5%	2.600%	9.7%
TLF for Entire Network (Reconciliation) Excluding ICC	1.093	1.093	1.093	1.028	1.107

**Table 3: Summary of overall losses on the TOPE Network (23 (d)).**

The above Distributor loss factor report is provided as per guideline (23) accompanied by the requested soft copy distributors report data (24).

Date of Response: 28/02/2013.

Signed By: 

---

Mr David Worsfold  
Network General Manager  
Top Energy Ltd