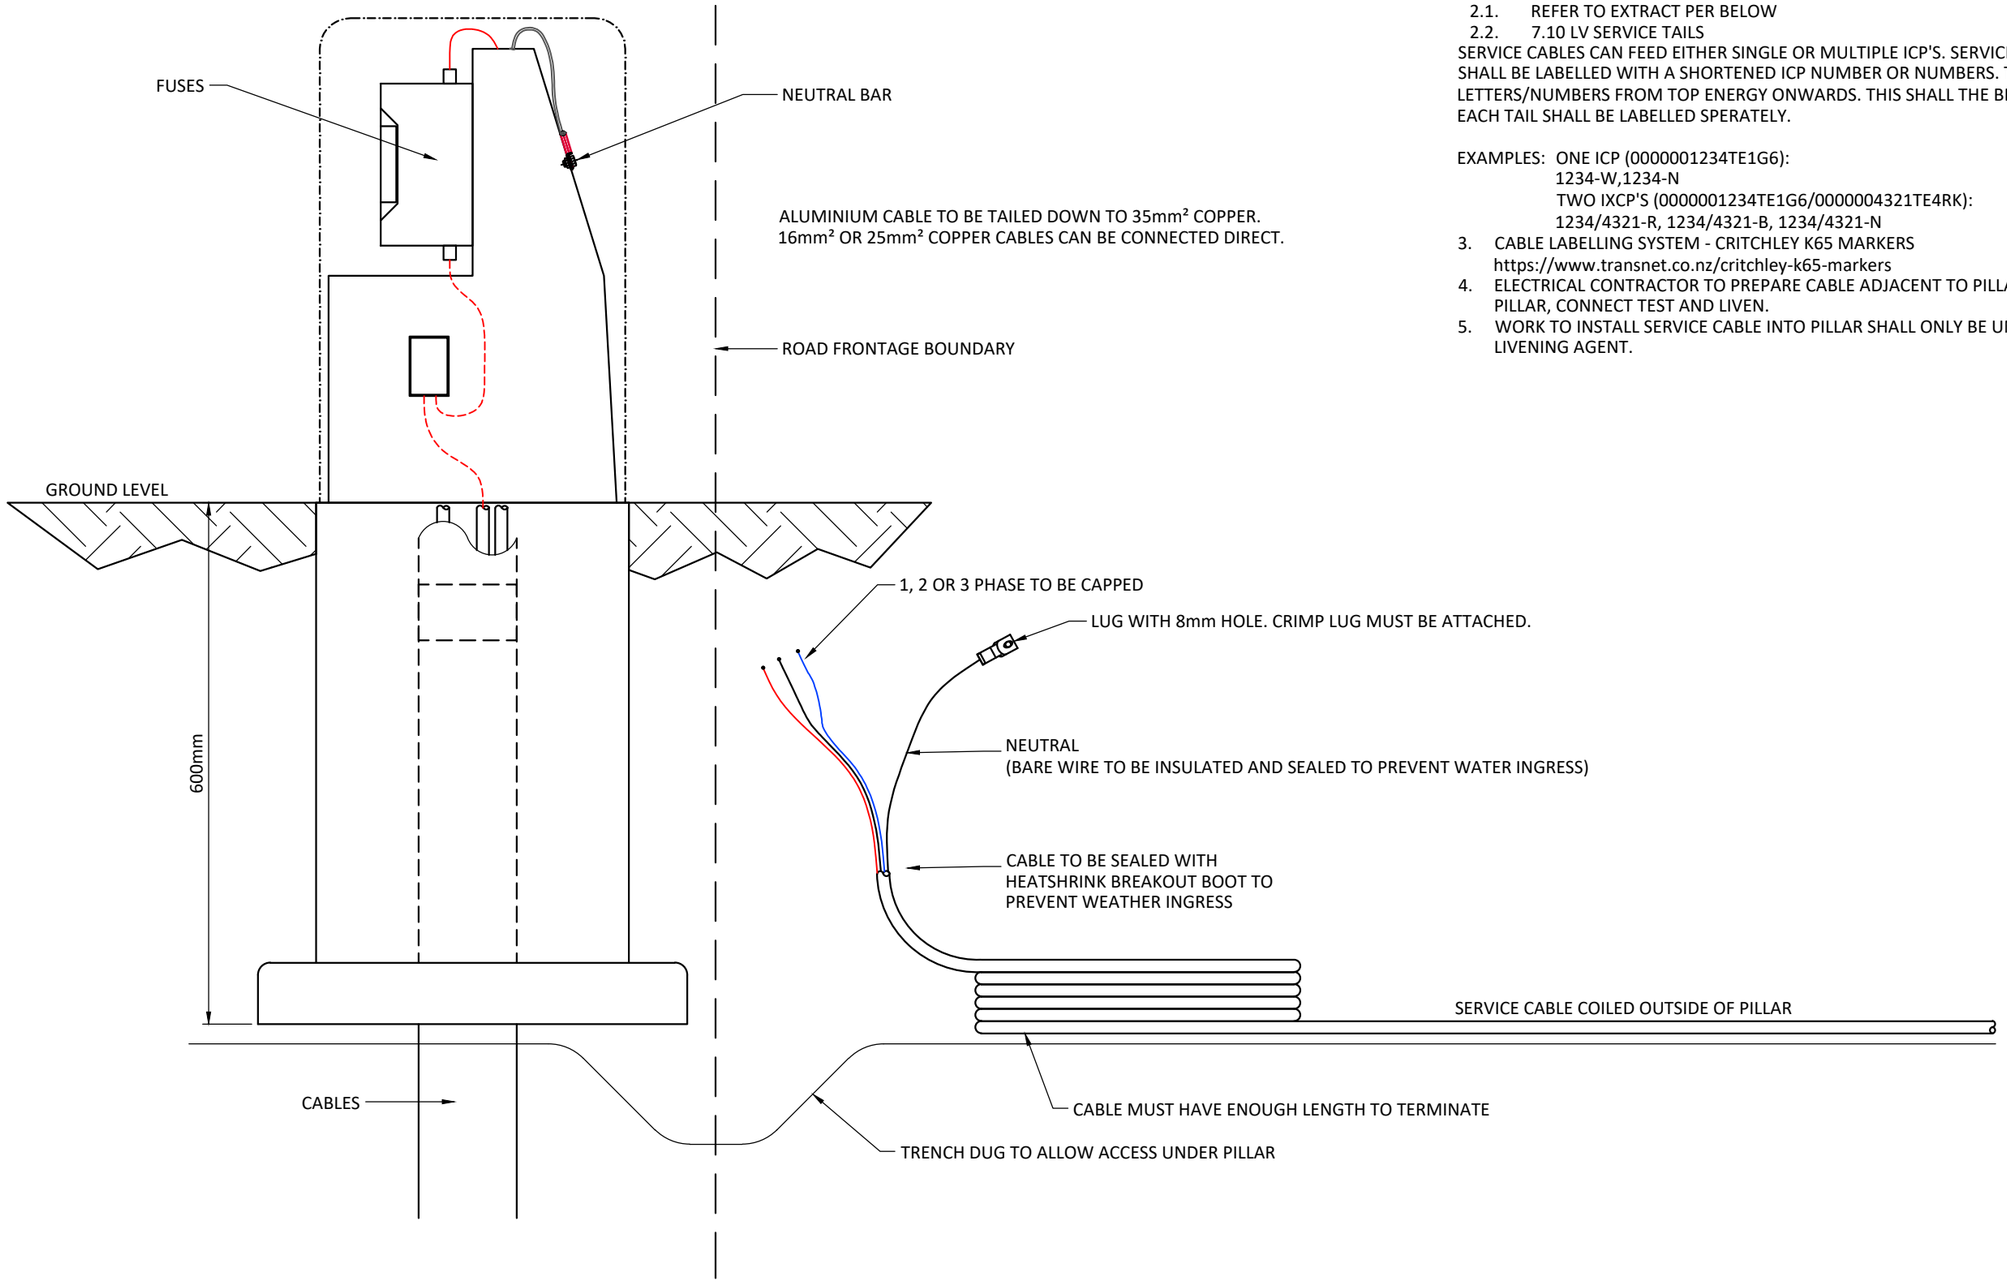


NOTES:
1. ALL SERVICE CABLE CONNECTIONS TO BE INTO TOP OF FUSE BASE.
2. LIVENING AGENT TO APPLY SERVICE CABLE LABELLING TO TOP ENERGY STANDARD ST-AM01-04-010S TOP ENERGY ASSET NAMING STANDARD
   - 2.1. REFER TO EXTRACT PER BELOW
   - 2.2. 7.10 LV SERVICE TAILS

SERVICE CABLES CAN FEED EITHER SINGLE OR MULTIPLE ICP'S. SERVICE CABLES THAT FEED ONE OR TWO ICP'S SHALL BE LABELLED WITH A SHORTENED ICP NUMBER OR NUMBERS. THIS SHALL DROP THE LEADING 0'S AND THE 5 LETTERS/NUMBERS FROM TOP ENERGY ONWARDS. THIS SHALL THE BE FOLLOWED BY THE PHASE INSTALLATION. EACH TAIL SHALL BE LABELLED SPERATELY.

EXAMPLES: ONE ICP (0000001234TE1G6):
1234-W,1234-N
TWO IXCP'S (0000001234TE1G6/0000004321TE4RK):
1234/4321-R, 1234/4321-B, 1234/4321-N

3. CABLE LABELLING SYSTEM - CRITCHLEY K65 MARKERS
   https://www.transnet.co.nz/critchley-k65-markers
4. ELECTRICAL CONTRACTOR TO PREPARE CABLE ADJACENT TO PILLAR FOR LIVENING AGENT TO INSTALL TO PILLAR, CONNECT TEST AND LIVEN.
5. WORK TO INSTALL SERVICE CABLE INTO PILLAR SHALL ONLY BE UNDERTAKEN BY A TOP ENERGY AUTHORISED LIVENING AGENT.

REV	REVISION DESCRIPTION	CONSULTANT DSN	CONSULTANT DRN	CONSULTANT CHK	CONSULTANT QCHK	APPROVED BY	APPROVED DATE
A	APPROVED FOR CONSTRUCTION	AB	CE	SCC	NS	SCC	11/26
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-

TOP ENERGY® TePuna Hihiko
Level 2, John Butler Centre
60 Kerikeri Rd, Kerikeri
PO Box 43, Kerikeri 0245
Ph: 09 401 5440
Fax: 09 401 5605
www.topenergy.co.nz

DRAWN: C EWINS	DATE: 04/11/2026	PROJECT: U - UNDERGROUND	DRAWING NUMBER: U1G0-0030-00 / REV: A
DESIGNER: S COOPER	DATE: 04/11/2026		
ENGINEER: N SOOKNANDAN	DATE: 04/11/2026	DRAWING TITLE: UG-LV-GROUND - STANDARD / TERMINATION / RESIDENTIAL PILLAR	
APPROVER: S COOPER	DATE: 04/11/2026	UG-LV-G-STD/TERM/RESD/PILLAR	

© COPYRIGHT 2026 ALL RIGHTS RESERVED TOP ENERGY LTD. UNAUTHORISED USE IS STRICTLY PROHIBITED BY NEW ZEALAND COPYRIGHT LAW.

A3